



www.archenvgroup.com
healthAIR - Industrial Hygiene Services
cleanWATER - Consulting & Testing Services
safeEARTH - Hazardous Waste & Recycling Services

December 4, 2020

Mr. Bernie Bowers
Operations Supervisor
Wyandotte Public Schools
639 Oak Street
Wyandotte, Michigan 48192
bbowers@wy.k12.mi.us

RE: **AEG Project # AE180812**
Lead Drinking Water Sampling
Washington Elementary School

Dear Mr. Bowers:

Pursuant to the request of Wyandotte Public Schools, Arch Environmental Group, Inc. (AEG) collected five (5) representative first draw drinking water lead samples on November 18, 2020, at Washington Elementary School.

General Information about Lead

There is no federal law requiring testing of drinking water in schools and childcare facilities, except for those that have and/or operate their own public water system and therefore are subject to comply with the Safe Drinking Water Act (SDWA). Drinking water programs are conducted on a voluntary basis.

Lead enters drinking water:

1. *Through Corrosion*
Most lead gets into drinking water after the water leaves the local well or treatment plant and comes into contact with plumbing materials containing lead. These include lead pipe and lead solder (commonly used until 1986) as well as faucets, valves, and other components made of brass. The physical/chemical interaction that occurs between the water and plumbing is referred to as corrosion. The extent to which corrosion occurs contributes to the amount of lead that can be released into the drinking water.
2. *Faucet Aerators*
Many taps that are used to provide water for human consumption have an aerator as part of the faucet assembly. Screens are not intended to remove contaminants in the water but may trap sediment or debris as water passes through the faucet. Lead bearing sediment may end up in drinking water from physical corrosion of leaded solder and can build up in the aerator over time.
3. *Galvanized Piping*
Additionally, galvanized pipes are old iron pipes that were installed in many homes built before the 1960s. Over many years, old corrosion scales build up inside the walls of galvanized pipes. These pipes can cause discolored water and pressure issues. Galvanized pipes can also release lead in water if you have or ever have had a lead service pipe.

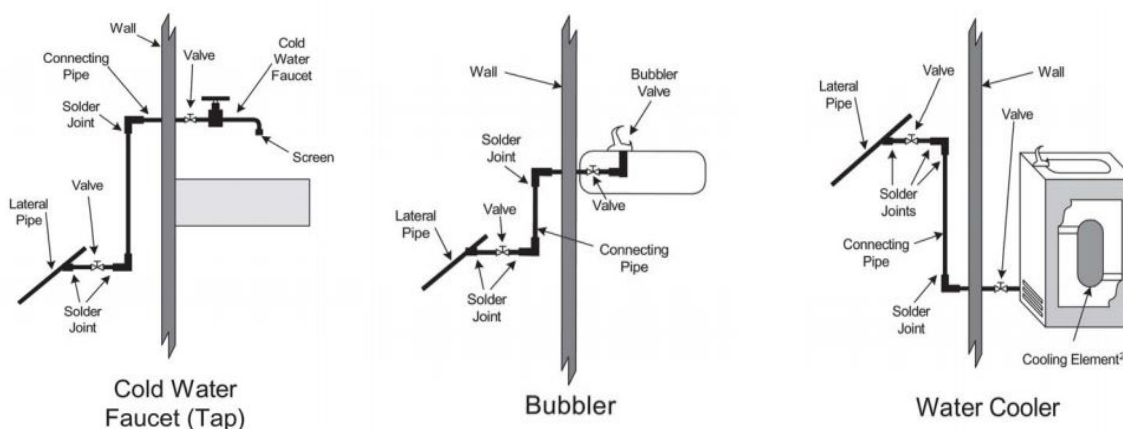
4. *Brass Pipes, Faucets Fittings and Valves*

Brass used prior to 2014 to deliver drinking water can contribute to lead levels at the tap. Lead has long been used in the foundry process to make brass castings pressure tight. Lead is sometimes added in concentrations of about 2%.

Action Levels

The Lead and Copper Rule (LCR) is a treatment technique rule. Instead of setting a maximum contaminant level (MCL) for lead or copper, the rule requires public water systems to take certain actions to minimize lead and copper in drinking water. The Action Level for lead is 15 ug/L (15 ppb). Beginning January 1, 2025, the action level for lead in the State of Michigan will be lowered to 12 ug/L (12 ppb). In August 2016, the Michigan Department of Environment, Great Lakes, and Energy (EGLE) recommended school districts use the contaminate level goal of 5 ug/L (5 ppb). Finally, in May of 2019, The American Academy of Pediatrics called for new federal standards to ensure water lead concentrations do not exceed 1 ug/L (1 ppb). For this sampling event, the District shall utilize 12 ug/L (ppb) as the Action Level.

Common Drinking Water Outlets



Collection Procedures

All water samples were collected utilizing 250 milliliters (mL) sample bottles as recommended in the August 1, 2016, Version 3.0 "EGLE Guidance on Drinking Water Sampling for Lead and Copper at Schools and Daycares on Community Water Supplies". Sample results are representative of the specific fixture sampled and do not represent the distribution system or other fixtures.

First Draw Sampling:

AEG collected first draw samples. A first draw is the water that is the first to come out of the tap after the period of 8-24 hours of inactivity.

All locations sampled identified lead below the 12 ug/L Action Level. No further action is recommended at this time.

If you have any questions regarding the report, please feel free to contact the cleanWATER team at (248) 426-0165 [office].

Sincerely,

Arch Environmental Group, Inc.
Environmental Services

Brendan Koziol

Brendan Koziol
Consultant

Attachments: Results Table
 Analytical Results & Chain of Custody



**Wyandotte Public Schools
Drinking Water Analysis
Project Number: AE180812**

| Washington Elementary School | | | | | | | |
|--|---|-------------------|----------------|--|---------------------|---------------------|-------------|
| Date of Sampling: November 18, 2020 | | | | | | | |
| Sampler: Evan Gist | | | | | | | |
| Sample # | Location | Type ¹ | Time Collected | District Lead Action Level (ug/L) ² | Lead Results (ug/L) | Aerator Present Y/N | Notes |
| Washington-01 | Kitchenette, Room 125, Kitchen Faucet | Kitchen Faucet | 8:38 AM | 12 | ND ³ | Yes | First Draw. |
| Washington-02 | Outside of Room 116, Hydration Station, Bottle Fill | Hydration Station | 8:41 AM | 12 | ND | Yes | First Draw. |
| Washington-03 | Outside of Room 216 ,Hydration Station, Bottle Fill | Hydration Station | 8:46 AM | 12 | ND | Yes | First Draw. |
| Washington-04 | Teachers Lounge, Room 222, 2 Compartment Sink, Kitchen Faucet | Kitchen Faucet | 8:49 AM | 12 | ND | Yes | First Draw. |
| Washington-05 | Room 126 , Facuet | Faucet | 8:53 AM | 12 | 1 | Yes | First Draw. |

1) Type: B = Bubbler, BT = Bottle Fill/Cooler, WC = Water Cooler, C = Combination Sink, F = Faucet, KF = Kitchen Faucet, I = Ice Machine, KK = Kitchen Kettle, PC = Plumed Coffee

2) <https://www.epa.gov/your-drinking-water/table-regulated-drinking-water-contaminant>

3) ND = Non Detected at Reported Detection Limit of 1 ug/L

4) NT = Not Tested

December 02, 2020

Arch Environmental Group
37720 Interchange Dr.
Farmington Hills, MI 48335

Subject: Washington Elementary School IFD
AE180812-WPS

Dear Ms. Eveleth :

Thank you for making Brighton Analytical, L.L.C. your laboratory of choice. Attached are the results for the samples submitted on 11/19/2020 for the above mentioned project. NELAP/TNI Accredited Analysis and EGLE Drinking Water Certified Analysis will be identified in their respective reporting formats. Hard copies can be supplied at your request for a fee of \$20.00 per copy.

The invoice for this project will be emailed separately. If you have any questions concerning the data or invoice, please don't hesitate to contact our office. We welcome your comments and suggestions to improve our quality systems. Please reference Brighton Analytical, L.L.C. Project ID 71790 when calling or emailing. We thank you for this opportunity to partner with you on this project and hope to work with you again in the future.

Sincerely,
Brighton Analytical, L.L.C.



Brighton Analytical LLC
2105 Pless Drive
Brighton, Michigan 48114
Phone: (810)229-7575 (810)229-8650
e-mail: bai-brighton@sbcglobal.net
EGLE Certified #9404
NELAC Accredited #176507

Sample Date/Time: 11/18/2020 08:38
Submit Date/Time: 11/19/2020 13:30
Report Date: 12/02/2020

Arch Environmental Group
37720 Interchange Dr.
Farmington Hills, MI 48335


BA Project # **71790** Project Name: **Washington Elementary School IFD**
BA Sample ID **CN07230** Project Number: **AE180812-WPS**
Sample ID: **Washington-01 Kitchenette Room 125**

| Analyte Name | Result | Units | RL | MCL | Method Reference | Analysis Time | Analysis Date |
|--------------------------------------|--------------|-------|-----|-----|------------------|---------------|---------------|
| Drinking Water Metal Analysis | | | | | | | |
| Total Lead (Drinking Water) | Not detected | ug/L | 1.0 | 15 | EPA 200.8 rev5.4 | 14:53 | 12/01/2020 |

RL=Reported detection limit for analytical method requested. Some compounds require special analytical methods to achieve EGLE designated target detection limits (TDL).

MCL = Maximum contaminant Levels.

Analysis not specifically identified as drinking water are for non-regulatory compliance purposes.

Released by 
Date 12/2/2020



Brighton Analytical LLC
2105 Pless Drive
Brighton, Michigan 48114
Phone: (810)229-7575 (810)229-8650
e-mail: bai-brighton@sbcglobal.net
EGLE Certified #9404
NELAC Accredited #176507

Sample Date/Time: 11/18/2020 08:41
Submit Date/Time: 11/19/2020 13:30
Report Date: 12/02/2020

Arch Environmental Group
37720 Interchange Dr.
Farmington Hills, MI 48335


BA Project # **71790**
BA Sample ID **CN07231**
Project Name: **Washington Elementary School IFD**
Project Number: **AE180812-WPS**
Sample ID: **Washington-02 Single Bottle Fill O/S Rm116**

| Analyte Name | Result | Units | RL | MCL | Method Reference | Analysis Time | Analysis Date |
|--------------------------------------|--------------|-------|-----|-----|------------------|---------------|---------------|
| Drinking Water Metal Analysis | | | | | | | |
| Total Lead (Drinking Water) | Not detected | ug/L | 1.0 | 15 | EPA 200.8 rev5.4 | 14:56 | 12/01/2020 |

RL=Reported detection limit for analytical method requested. Some compounds require special analytical methods to achieve EGLE designated target detection limits (TDL).

MCL = Maximum contaminant Levels.

Analysis not specifically identified as drinking water are for non-regulatory compliance purposes.

Released by 
Date 12/2/2020



Brighton Analytical LLC
2105 Pless Drive
Brighton, Michigan 48114
Phone: (810)229-7575 (810)229-8650
e-mail: bai-brighton@sbcglobal.net
EGLE Certified #9404
NELAC Accredited #176507

Sample Date/Time: 11/18/2020 08:46
Submit Date/Time: 11/19/2020 13:30
Report Date: 12/02/2020

Arch Environmental Group
37720 Interchange Dr.
Farmington Hills, MI 48335


BA Project # **71790**
BA Sample ID **CN07232**
Project Name: **Washington Elementary School IFD**
Project Number: **AE180812-WPS**
Sample ID: **Washington-03 Single Bottle Fill O/S Rm216**

| Analyte Name | Result | Units | RL | MCL | Method Reference | Analysis Time | Analysis Date |
|--------------------------------------|--------------|-------|-----|-----|------------------|---------------|---------------|
| Drinking Water Metal Analysis | | | | | | | |
| Total Lead (Drinking Water) | Not detected | ug/L | 1.0 | 15 | EPA 200.8 rev5.4 | 14:59 | 12/01/2020 |

RL=Reported detection limit for analytical method requested. Some compounds require special analytical methods to achieve EGLE designated target detection limits (TDL).

MCL = Maximum contaminant Levels.

Analysis not specifically identified as drinking water are for non-regulatory compliance purposes.

Released by 
Date 12/2/2020



Brighton Analytical LLC
2105 Pless Drive
Brighton, Michigan 48114
Phone: (810)229-7575 (810)229-8650
e-mail: bai-brighton@sbcglobal.net
EGLE Certified #9404
NELAC Accredited #176507

Sample Date/Time: 11/18/2020 08:49
Submit Date/Time: 11/19/2020 13:30
Report Date: 12/02/2020

Arch Environmental Group
37720 Interchange Dr.
Farmington Hills, MI 48335


BA Project # **71790** Project Name: **Washington Elementary School IFD**
BA Sample ID **CN07233** Project Number: **AE180812-WPS**
Sample ID: **Washington-04 Teachers Lounge Room 222**

| Analyte Name | Result | Units | RL | MCL | Method Reference | Analysis Time | Analysis Date |
|--------------------------------------|--------------|-------|-----|-----|------------------|---------------|---------------|
| Drinking Water Metal Analysis | | | | | | | |
| Total Lead (Drinking Water) | Not detected | ug/L | 1.0 | 15 | EPA 200.8 rev5.4 | 15:02 | 12/01/2020 |

RL=Reported detection limit for analytical method requested. Some compounds require special analytical methods to achieve EGLE designated target detection limits (TDL).

MCL = Maximum contaminant Levels.

Analysis not specifically identified as drinking water are for non-regulatory compliance purposes.

Released by 
Date 12/2/2020



Brighton Analytical LLC
2105 Pless Drive
Brighton, Michigan 48114
Phone: (810)229-7575 (810)229-8650
e-mail: bai-brighton@sbcglobal.net
EGLE Certified #9404
NELAC Accredited #176507

Sample Date/Time: 11/18/2020 08:53
Submit Date/Time: 11/19/2020 13:30
Report Date: 12/02/2020

Arch Environmental Group
37720 Interchange Dr.
Farmington Hills, MI 48335


BA Project # **71790**
BA Sample ID **CN07234**
Project Name: **Washington Elementary School IFD**
Project Number: **AE180812-WPS**
Sample ID: **Washington-05 Rm 126 Single Compartment Sink**

| Analyte Name | Result | Units | RL | MCL | Method Reference | Analysis Time | Analysis Date |
|--------------------------------------|--------|-------|-----|-----|------------------|---------------|---------------|
| Drinking Water Metal Analysis | | | | | | | |
| Total Lead (Drinking Water) | 1 | ug/L | 1.0 | 15 | EPA 200.8 rev5.4 | 15:11 | 12/01/2020 |

RL=Reported detection limit for analytical method requested. Some compounds require special analytical methods to achieve EGLE designated target detection limits (TDL).

MCL = Maximum contaminant Levels.

Analysis not specifically identified as drinking water are for non-regulatory compliance purposes.

Released by 
Date 12/2/2020



BRIGHTON ANALYTICAL, LLC

QUALITY ASSURANCE/QUALITY
CONTROL

ICP-MS

METHOD 200.8/6020

REPRESENTATIVE BATCH PRECISION AND ACCURACY QUALITY CONTROL SUMMARY

| | | |
|------------------------------|-------------------------|----------------------|
| Analysis Date: 12/1/2020 | Standard ID: 111120 H2O | Batch: 11/24/2020 B3 |
| Matrix Spike Lab ID: CN07234 | Matrix: Total | Analyst: MII |

| Metals | Matrix Spike - Precision * | | | Matrix Spike - Accuracy** | | | | Miscellaneous*** | | |
|--------|----------------------------|-------------------------|---------|---------------------------|-----------------|------------------|--------------------|-------------------|--------------------|---------------|
| | Matrix Spike (ug/L) | Matrix Spike Dup (ug/L) | RPD (%) | Spk Conc (ug/L) | MS Recovery (%) | MSD Recovery (%) | Sample Conc (ug/L) | Method Blk (ug/L) | LCS-Method STD (%) | Ind. Std. (%) |
| Lead | 1004 | 1081 | 7.4 | 1000 | 100.3 | 108.0 | 1 | <1 | 101.4 | 107.1 |

* Matrix spike precision range +/- 20% RPD

** Matrix spike accuracy range +/- 20% recovery

*** LCS accuracy range +/- 15% recovery / Ind std accuracy range +/- 10% recovery

Comments: _____